**INTERN-TURN AND BEARING WEAR FAULT DETECTION IN  
THREE PHASE INDUCTION MOTOR MATLAB SIMULINK****Dr. Z. J. Khan\*<sup>1</sup> and V. P. Dongare<sup>2</sup>**<sup>1</sup>Professor and Head Electrical Engg. Dept. RCERT Chandrapur India.<sup>2</sup>Testing Unit, Amravati, (M.S.) India.

Article Received on 20/07/2017

Article Revised on 09/08/2017

Article Accepted on 30/08/2017

**\*Corresponding Author****Dr. Z. J. Khan**Professor and Head  
Electrical Engg. Dept.  
RCERT Chandrapur India.**ABSTRACT**

Induction Motor is one of the most widely used machines in the industries because of its simple structure and high reliability. It is backbone of modern industry, especially squirrel cage induction motor.

It is used for many purposes, such as blower, compressor, fan, pump, manufacturer, transportation etc. In this paper, the dynamic mathematical modeling of 3 phase Induction motor and its simulation model using MATLAB Simulink has been developed for incipient faults viz. turn to turn fault and insulation failure. Also, the detailed simulation results using Matlab are presented.

**KEYWORDS:** Induction motor, incipient faults, Mathematical modeling, MATLAB Simulink.

**INTRODUCTION**

There are two kinds of Induction rotating motors, the squirrel –cage induction motor and the wounded rotor motor. Since the squirrel cage induction motor is low-priced, robust and rugged, simple and easy to maintain, it has become the most commonly used electrical rotating machine in industry .It is becoming increasingly important to used condition monitoring. Techniques to give early warning of imminent failure.

Under normal operating conditions. The components of Induction motor are subjected to thermal, mechanical and electrical stresses. This tresses may be increased due to transient such as load and supply variation, may cause insulation and mechanical failure of induction

motors. Failure may cause large amount of loss if it is not detected and corrected in time. So the developing faults should be detected and corrected in time to prevent catastrophic failures (sudden terrible disaster)

**Insulation failure** Major insulation failures are caused by moisture, Over-temperature, system surge and faulty earth practice.

*Moisture* ingress may cause insulation failures for resin rich insulation system and their predecessors.

On small machine *over temperature* is the major contributor to insulation failure. It can be shown that for every 10 degree increase in hot spot temperature, reduced life span to 50% and exceeds the insulation system rating. Over temperature may be caused by ventilation blockage or over loading, broken rotor bar and a cracked end ring on cage machines also contributes to this problem.

*System surges* normally damages the first or second coil insulation, resulting in an inter-turn failure close to the line terminal.

*A faulty earth* may lead to neutral inversion during fault conditions causing the three phases to float away from earth to dangerously high level.

**Mechanical failure:** The major faults in this category can be broadly classified as follows.

**On stator:** Opening and shorting of one or more phase of stator winding **or** abnormal connection of same winding.

**On rotor:** broken rotor bars or cracked rotor end rings.

**Rotor eccentricity:** i) static and /or dynamic air gap irregularities ii) Bent shaft (dynamic eccentricity)-which can result in a rub between the rotor and stator, causing serious damaged to stator core and winding.

**Bearing damaged:** Bearing & gear box failure.

This fault produces one or more symptoms as given below:

- i) Unbalanced Air gap voltage and currents.
- ii) Increased torque pulsation and decrease average torque.

- iii) Increased losses, excessive heating and reduction in efficiency.
- iv) Specified harmonics in the line current increased.
- v) Leakage flux in axial direction.

The possible detection methods to identify the motor faults are listed as below:

- i) Vibration monitoring.
- ii) Motor current signature analysis.
- iii) Electromagnetic field monitoring using search coil.
- iv) Chemical analysis.
- v) Temperature measurement.
- vi) Infrared measurement.
- vii) Acoustic noise measurement.
- viii) Radio frequency emission monitoring.
- ix) Partial discharge measurement.
- x) Model, artificial intelligence & neural network based technique.

### Induction Machine Modelling

This model follows the complete magnetic approach by treating the current in each rotor bar as an independent variable. The effect of non-sinusoidal air gap MMF produced by both the stator and rotor currents have been incorporated into this model. This is done by use of the winding function approach.

The analysis is based on the following assumption Symmetric machine, Uniform air gap, negligible saturation and Insulated rotor bar.

Squirrel cage IM simplified scheme is given as.

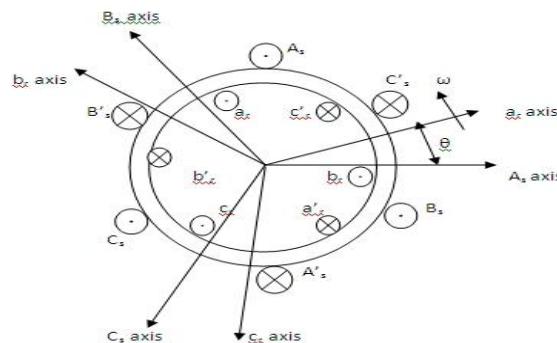


Fig. 1: Squirrel cage IM simplified scheme.

### A. Stator voltage Equation.

The stator equations for the induction motor with ref. to fig. 1 can be written in vector matrix form as.

$$[V_s] = [R_s][I_s] + d/dt[\lambda_s] \quad (1)$$

Where

$$\begin{aligned} [V_s] &= [V_{s1} \ V_{s2} \ V_{s3}]^T \\ [I_s] &= [I_{s1} \ I_{s2} \ I_{s3}]^T \quad \& \\ [\lambda_s] &= [\lambda_{s1} \ \lambda_{s2} \ \lambda_{s3}]^T \end{aligned} \quad (2)$$

Also

$$[\lambda_s] = [L_{ss}][I_s] + [L_{sr}][I_r] \quad (3)$$

Where

$[R_s]$ - Resistance of stator winding (Diagonal 3 by 3 matrix)

$[\lambda_s]$ - Flux linkage of stator winding (Symmetric 3 by 3 matrix)

$[L_{ss}]$ -Self-inductance of stator winding (Symmetric 3 by 3 matrix)

$[L_{sr}]$ -Mutual inductance between stator coils & rotor loops (Symmetric 3 by 3 matrix)

$$[L_{rr}] = \begin{bmatrix} L_{sr11} & L_{sr12} & \dots & L_{sr1n} & L_{sr1e} \\ L_{sr21} & L_{sr22} & \dots & L_{sr2n} & L_{sr2e} \\ L_{sr31} & L_{sr32} & \dots & L_{sr3n} & L_{sr3e} \end{bmatrix} \quad (4)$$

Where


$L_{sr_{ij}}$ - Mutual inductance between the stator phase  $i$  ( $i=1,2$  or  $3$ ) and rotor loop  $j$

$L_{sr_{ie}}$ - Mutual inductance between the stator phase  $i$  ( $i=1,2$  or  $3$ ) and the end ring

### B. Rotor Voltage Equation

Given the structural symmetry of the rotor, it is convenient to model the cage as identical magnetically coupled circuits. For simplicity, we assume that each loop is defined by two adjacent rotor bars and the connecting portions of the end rings between them.

For the purpose of analysis, each rotor bar & segment of end rings is substituted by an equivalent circuit representing the resistive and inductive nature of the cage. Such an equivalent ckt is shown in.

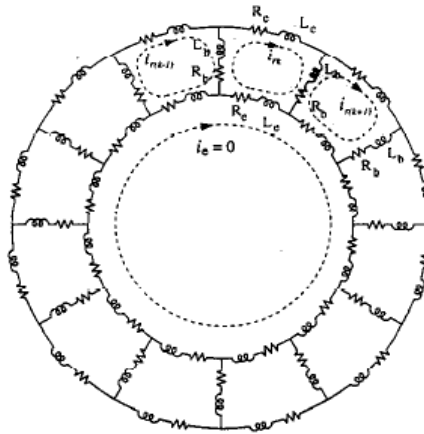

**Fig. 2: Rotor cage equivalent circuit showing rotor loop currents & circulating end ring current.**

From fig.No.2.The voltage equations for the rotor lops can be written in vector matrix form as,

$$[V_r] = [R_r] [I_r] + d/dt [\lambda_r] \quad (5)$$

Where

$$[V_r] = [V_{r1} \ V_{r2} \ \dots \ V_{rk} \ V_{re}]^T \quad (6)$$

Where  $k=1,2,\dots,n$

In case of cage rotor, The rotor loop voltage  $V_{rk}=0$  and end ring voltage  $V_{re}=0$

The loop equation for  $k^{th}$  rotor ckt is

$$V_{rk}=0=2(R_b+R_e)I_{rk}-R_bI_r(K-1)-R_bI_r(K+1)-R_eI_e+d\lambda_{rk}/dt \quad (7)$$

The voltage equation for the end ring is

$$V_{re}=0= -R_eI_{r1}-R_eI_{r2}-R_eI_m+nR_eI_{re}+d\lambda_{rk}/dt \quad (8)$$

Where,  $R_b$  is the rotar bar resistance &  $R_e$  is the end ring segment resistance

Since each loop is assumed to be identical, the equation (7) is valid for every loop.

Therefore the resistance matrix  $[R_e]$  is symmetric  $(n+1)$  by  $(n-1)$  matrix given by

$$[R_r] = \begin{bmatrix} 2(R_b + R_e) & R_b & 0 & \dots & 0 & -R_b & -R_e \\ -R_b & 2(R_b + R_e) & -R_b & \dots & 0 & 0 & -R_e \\ \dots & \dots & \dots & \dots & \dots & \dots & \dots \\ \dots & \dots & \dots & \dots & \dots & \dots & \dots \\ 0 & 0 & 0 & \dots & 2(R_b + R_e) & -R_b & -L_e \\ Ln_1-Lb & 0 & 0 & \dots & -R_b & 2(R_b + R_e) & -L_e \\ -R_e & -R_e & -R_e & \dots & -R_e & -R_e & -nR_e \end{bmatrix} \quad (9)$$

n relation (5) the rotor flux can be written as

$$[\lambda_r] = [L_{rs}][I_s] + [L_{rr}][I_r] \quad (10)$$

Where  $[\lambda_r]$ - Flux linkage of rotor

$[L_{rr}]$ -Self-inductance of rotor

$[L_{rs}]$ -Mutual inductance between stator coils & rotor loops

$[L_{rr}] =$

$$\begin{bmatrix} L_{11} + 2(L_b + L_g) & L_{12} - L_b & L_{13} & \dots & L_{1(n-1)} & L_{1n} - L_b & -L_g \\ L_{21} - L_b & L_{22} + 2(L_b + L_g) & L_{23} - L_b & \dots & L_{2(n-1)} & L_{2(n-1)} & -L_g \\ \dots & \dots & \dots & \dots & \dots & \dots & \dots \\ \dots & \dots & \dots & \dots & \dots & \dots & \dots \\ L_{(n-1)} & L_{(n-1)2} & L_{(n-1)3} & \dots & L_{(n-1)(n-1)} + 2(L_b + L_g) & L_{n(n-1)} - L_b & -L_g \\ Ln_1 - L_b & Ln_2 & Ln_3 & \dots & Ln(n-1) - L_b & Ln_n + 2(L_b + L_g) & -L_g \\ -L_g & -L_g & -L_g & \dots & -L_g & -L_g & -nL_g \end{bmatrix}$$

*C. Calculation of Torque*

The mechanical equation of machine is

$$T_{em} - T_L = J \, d\omega_m / dt \quad (12)$$

Where

$T_{em}$ - Electromagnetic torque

$T_L$ -Load torque

$J$ - Inertia of the rotor

$$\omega_m = 1/p \, d\theta / dt \quad (13)$$

Where  $\theta$  is the angular position of the rotor &  $p$  denotes the number of motor pole pairs and  $\omega_m$ -mechanical speed

The electromagnetic torque is given by


$$T_{em} = P I_s^t \{ d/d\theta [L_{sr}] \} I_r \quad (14)$$

*Incipient Faults*

There are various incipient faults occurs in induction machine as discuss above. In this paper mathematical modeling and mat lab simulation of only two types of faults are discuss such as turn to turn faults, and bearing fault.

Turn to Turn Fault in Stator Winding (Mathematical modeling).

Let us consider turn-to-turn fault on phase A as shown in fig.

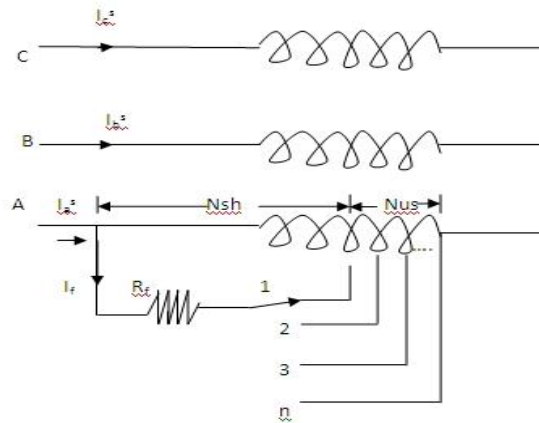

**Fig. 3: Turn to turn fault on phase A.**

Winding in phase A is divided on two parts, unfaulted turns winding section  $N_{us}$  and shorted turns winding section  $N_{sh}$  as in fig given. Turns sum  $N_{us}$  and  $N_{sh}$  is the total turns of the winding which is  $N_s$  ( $N_s = N_{us} + N_{sh}$ ) of phase A. Phase B and C have the same number of turns equal  $N_s$ .

Let the impedance of stator winding per turn  $Z_s$  under healthy condition is defined as.


$$Z_s = Z/N_s$$

Where  $Z$  is stator impedance under healthy condition and  $N_s$  indicates number of stator winding turns. The rms.

value of stator input current of particular phase is normal under healthy condition and expressed as.

$$I_s \angle \theta = V_s / z$$

Where  $I_s$  is rms value of sator current at an angle  $\theta$ ; and  $V_s$  is rms value of supply voltage Whenever inter-turn short circuit fault take place, certain contact resistance between two turns ( $r_s$ ) comes across where the short circuit is introduced as shown in fig.4. due to this short, magnitude of  $Z_s$  decreases to  $Z_f$  as expressed below.

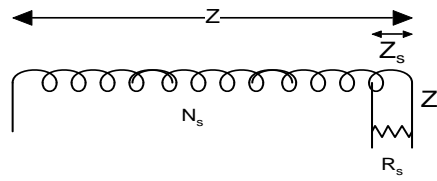

**Fig. 4: Inturn-turn short circuit fault.**

$$Z_f = \frac{(Z_s r_s)}{(Z_s + r_s)} \quad (15)$$

This affects the winding impedance  $Z$  depending upon the number of shorted turns. As more number of turns get shorted,  $Z$  decreases to  $Z_f$ . At constant load and voltage condition, the decrease in magnitude of  $Z$  increases the stator fault is current ( $I_{sf}$ ).

This is expressed by following equation.

$$I_{sf} \angle \phi = \frac{V_s}{Z_f} \quad (16)$$

Where  $\phi$  is phase angle of current and  $Z_f$  is the stator impedance under unhealthy condition. Equation (2) and (4) enables us to write deviation in stator intake current as follows.

$$I_{sd} \angle \delta = I_{sf} \angle \phi - I_s \angle \theta \quad (17)$$

From above equation it is possible to establish the relation of stator intake current and stator inter-turn fault. Under healthy winding condition  $I_{sd}=0$  and  $\angle \delta=0$ . The three phase motor currents are given as,

$$\left. \begin{aligned} i_a &= I_{ma} \sin(\omega t + \theta_a) \\ i_b &= I_{mb} \sin\left(\omega t - \frac{2\pi}{3} + \theta_b\right) \\ i_c &= I_{mc} \sin\left(\omega t + \frac{2\pi}{3} + \theta_c\right) \end{aligned} \right\} \quad (18)$$

where  $I_{ma}$ ,  $I_{mb}$  and  $I_{mc}$  are peak values of three phase currents,  $\theta_a$ ,  $\theta_b$  and  $\theta_c$  are phase unbalanced in degrees. This current can be resolved into zero positive and negative sequence currents based on instantaneous symmetrical component theory and are expressed as below.

$$\begin{bmatrix} I_{a_0} \\ I_{a_1} \\ I_{a_2} \end{bmatrix} = \frac{1}{3} \begin{bmatrix} 1 & 1 & 1 \\ 1 & a & a^2 \\ 1 & a^2 & a \end{bmatrix} \begin{bmatrix} I_a \\ I_b \\ I_c \end{bmatrix} \quad (19)$$



where  $a=e^{\frac{j2\pi}{3}}$  is complex operator .The instantaneous vector  $i_{a1}$  and  $i_{a2}$  are complex conjugate of each other and  $i_{a0}$  is a real quantity which are positive, negative and zero sequence currents. From the observation, it is clear that the negative sequence current exhibits unbalanced of stator intake current due to intern –turn short circuit faults .the sequence components of voltage of three phase ac machine in steady state can be expressed as.

$$\begin{bmatrix} Va_0 \\ Va_1 \\ Va_2 \end{bmatrix} = \begin{bmatrix} Z_{00} & Z_{01} & Z_{02} \\ Z_{10} & Z_{11} & Z_{12} \\ Z_{20} & Z_{21} & Z_{22} \end{bmatrix} \begin{bmatrix} Ia_0 \\ Ia_1 \\ Ia_2 \end{bmatrix} \quad (20)$$

Where subscript 0, 1 and 2 represents zero ,positive and negative sequence components of voltage and current phasors respectively ,and  $Z_{ij}$  represents the impedance of the  $i$  sequence due to  $j$  sequence .The  $Z_{ij}$  impedance are function of motor design ,construction and any internal deterioration and the operating speed . In this work, it is assumed that  $ia_0 =0$  because zero sequence current flows only when fault take place through ground and therefore concentrate on the main problem of detecting inter-turn insulation fault that does not involve ground .Thus equation (20) is written as.

$$\begin{bmatrix} Va_1 \\ Va_2 \end{bmatrix} = \begin{bmatrix} Z_{11} & Z_{12} \\ Z_{21} & Z_{22} \end{bmatrix} \begin{bmatrix} Ia_1 \\ Ia_2 \end{bmatrix} \quad (21)$$

The above equation (21) can be modified as.

$$\begin{bmatrix} Ia_1 \\ Ia_2 \end{bmatrix} = \begin{bmatrix} Z_{11} & Z_{12} \\ Z_{21} & Z_{22} \end{bmatrix}^{-1} \begin{bmatrix} Va_1 \\ Va_2 \end{bmatrix} \quad (22)$$

From equation (21) the steady state negative sequence voltage for induction motor with inherent asymmetries can be described as.

$$V_{a2}=Z_{21}I_{a1}+Z_{22} I_{a2} \quad (23)$$

When turn fault occurs, value of  $Z_{21}$  varies since the motor becomes asymmetric and hence turn faults can be detected by continuously monitoring  $Z_{21}$ .The deviation in  $Z_{21}$ ,The deviation in  $Z_{21}$ ,, which is used as a turn fault indicator is define as.

$$\Delta Z_{21} = Z_{21} -Z_{210} \quad (24)$$

Thus the historical data  $Z_{210}$  is required to detect the condition of winding insulation

The sum of the phase voltages is given by the following relationship

$$V=V_a+V_b+V_c \quad (25)$$

Where

$$\begin{bmatrix} V_a \\ V_b \\ V_c \end{bmatrix} = \begin{bmatrix} Z_a & 0 & 0 \\ 0 & Z_b & 0 \\ 0 & 0 & Z_c \end{bmatrix} \begin{bmatrix} I_a \\ I_b \\ I_c \end{bmatrix} \quad (26)$$

For induction motor drawing balance currents, the three phase sequence impedance are equal ie

$$Z_a = Z_b = Z_c \quad (27)$$

In the above equations ,  $V_a$  ,  $V_b$  and  $V_c$  are phase voltages,  $I_a$  , $I_b$  and  $I_c$  are phase current and  $Z_a$ ,  $Z_b$  and  $Z_c$  are the impedance of each phase respectively .In a three phase connection for solidly ground ,wye –connected motor.

$$I_a +I_b +I_c=0 \quad (28)$$

The Equation (15), can be written as,


$$\frac{V_a}{Z_a} + \frac{V_b}{Z_b} + \frac{V_c}{Z_c} = 0 \quad (29)$$

The unbalance in magnitude of currents and phase angles is mainly due to unbalance supply voltage, constructional imperfections in design of stator winding, instrumentation difference and inter-turn short ckt fault. If due to any of these reasons, for example, unbalance supply voltage, (let  $Z_a =Z_b =Z_c$  and  $V_a \neq V_b \neq V_c$ ) as shown in Fig. 5 equation (29) is no longer valid and it becomes

$$\frac{V_a}{Z_a} + \frac{V_b}{Z_b} + \frac{V_c}{Z_c} \neq 0$$

or

$$I_a+I_b+I_c \neq 0$$

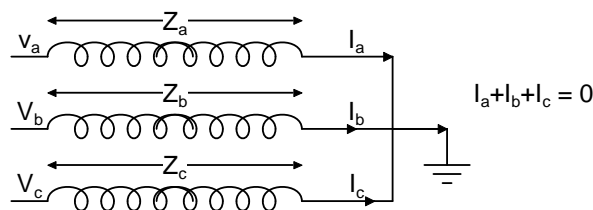

**Fig. 5: Stator winding of motor under imbalance supply voltage condition.**

The model of a faulty motor can be derived from standard relations

$$d\lambda_s/dt = V_s - R_s I_s \quad (30)$$

$$d\lambda_r/dt = -R_r I_r \quad (31)$$

As a symmetrical machine is considered it is assumed  $R_s=r_s I$  and  $R_r=r_r I$  where  $I$  is diagonal matrix.

$$[\lambda_s] = [L_{ss}][I_s] + [L_{sr}][I_r] \quad (32)$$

$$[\lambda_r] = [L_{rs}][I_s] + [L_{rr}][I_r] \quad (33)$$

Flux equation of Induction motor with turn to turn fault in stator takes the following form,

$$d\lambda_s/dt = V_s - R_s (I_s - N_f i_f) \quad (34)$$

$$d\lambda_r/dt = -R_r I_r \quad (35)$$

$$\lambda_s = L_{ss} (I_s - N_f I_f) + L_{sr} I_r \quad (36)$$

$$\lambda_r = L_{rs} (I_s - N_f I_f) + L_{rr} I_r \quad (37)$$


Where  $N_f = [N_{sh} \ 0 \ 0]^T$  is a vector representing position of turn to turn fault in the stator ckt.

The flux in circulated part of winding A can be calculated according to the following equation.

$$d\lambda_a^{sh}/dt = R_f i_f - N_{sh} R_s (i_a^s - i_f) \quad (38)$$

### Bearing Fault (Mathematical modeling)

The characteristic vibration frequencies due to bearing defects can be calculated from the rotor speed and the bearing geometry. The typical rolling element bearing geometry is displayed in fig. The characteristic vibration frequency  $f_v$  can be calculated using following equation. corresponding temperature rise in stator, thereby decreasing the life expectancy of the stator winding insulation.

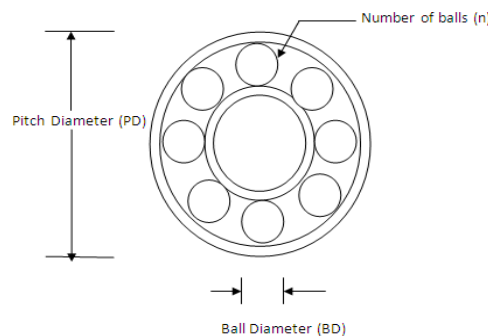

**Fig. 6: The typical rolling element bearing geometry.**

The outer race defect frequency,  $F_{OD}$  The ball passing frequency on the outer race is given by

$$F_{OD} = n/2 f_{rm} (1 - BD/PD \cos\phi) \quad (39)$$

Where  $\phi$ =contact angle

PD =Pitch Diameter

BD= Ball Diameter

$n$ = $n$  is the number of balls

$f_{rm}$ = rotational speed

The inner race defect frequency  $F_{ID}$  the ball passing frequency on the inner race is given by

$$F_{ID} = n/2 f_{rm} (1 + BD/PD \cos\phi) \quad (40)$$

The ball defect frequency  $F_{BD}$  (The ball spin frequency is given by)

$$F_{BD} = PD/2BDf_{rm} \{ 1 - (BD/PD)^2 \cos^2\phi \} \quad (41)$$

The train defect frequency  $F_{TD}$  caused by an irregularity in the train is given by

$$F_{TD} = 1/2 f_{rm} (1 - BD/PD \cos\phi) \quad (42)$$

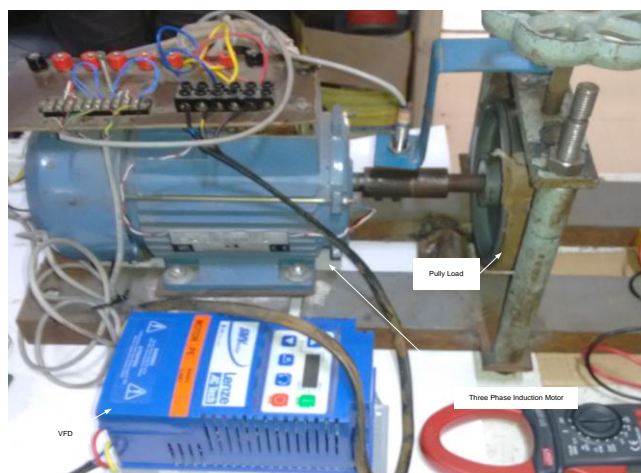
The characteristic current frequency  $F_{CF}$  due to the bearing characteristic vibration frequency  $f_v$  are calculated by.

$$F_{CF} = |f_e \pm mf_v| \quad (43)$$

Where  $m=1, 2, 3, \dots$  &  $f_e$  is the power line frequency.

This latter equation represents an amplitude modulation of the stator current by the bearing vibration.

### Experimental Setup



The squirrel cage Induction motor used for Matlab simulation is having the following parameters:





S. No.	Parameter	Rating
1	Ambient temperature in degree cent.	30
2	Voltage in volts	415
3	Capacity in hp	1
4	Frequency in Hz	50
5	No. of poles	4
6	Speed in rpm at no load in rpm	1500
7	Speed in rpm at full load in rpm	1400
8	Total No.of slots	24
9	Torque in N-m at noload	4.77
10	Full load torque in N-m	5.11
11	Motor efficiency at rated load in %age	72.1
12	Power factor at rated load	0.72
13	Gauge of winding	23
14	Turn of stator winding	109
15	No. of rotor bars	18
16	Length of winding in mm	320
17	Bearing numbers	6204

### SIMULATED RESULT

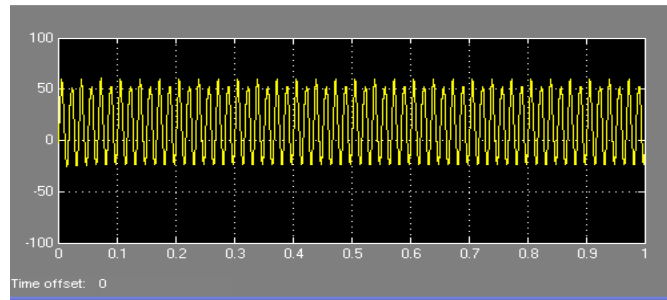
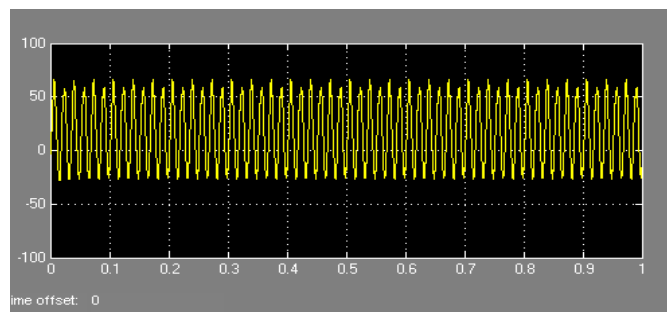
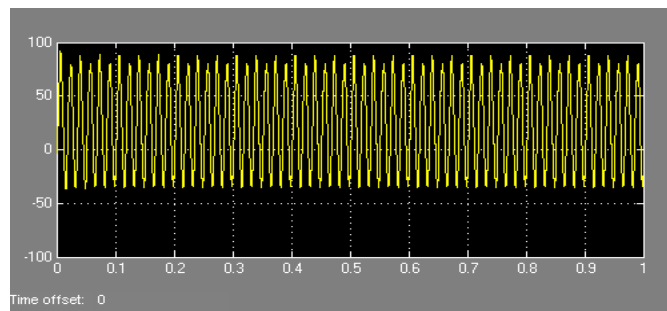
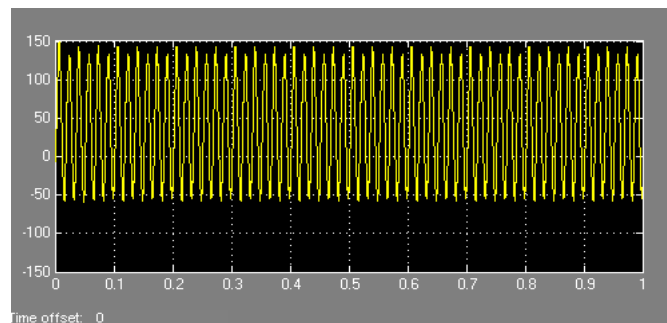
The decrease in winding equivalent turns will increase the stator –winding current as shown in fig.6 (a), thus causing increase in heating due to additional  $I^2R$  losses. The increase in heating will cause a corresponding temperature rise in stator, thereby decreasing the life expectancy of the stator winding insulation.

The stator winding insulation failure will cause additional shorted turns and further increase in temperature. This effect increases the rate of deterioration of the stator winding insulation. This insulation failure of winding may touch the body of motor which take place a ground fault passing fault current through ground .The faulted phase carry a large current through ground as shown in fig.8 (a).





If the machine bearing is healthy in that case, motor intake current is normal. But as the bearing deteriorates, to fulfill the required load demand, the electrical torque increases. Therefore, the input current also rises.

**A) Turn to turn fault****a) Current of Phase A (Turn to turn fault at total winding)****b) Current of Phase A (Turn to turn fault by shorting 20% of total winding)****c) Current of Phase A (Turn to turn fault by shorting 50% of total winding)****d) Current of Phase A (Turn to turn fault by shorting 75 % of total winding)**

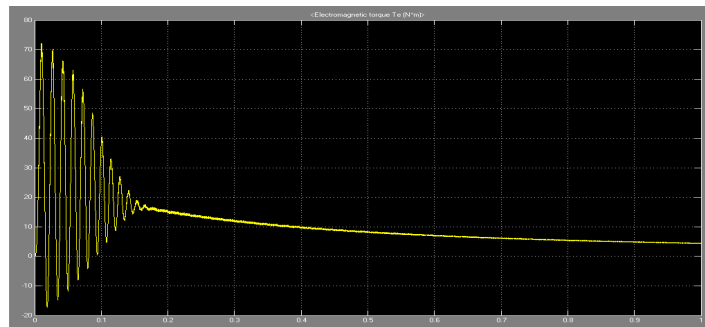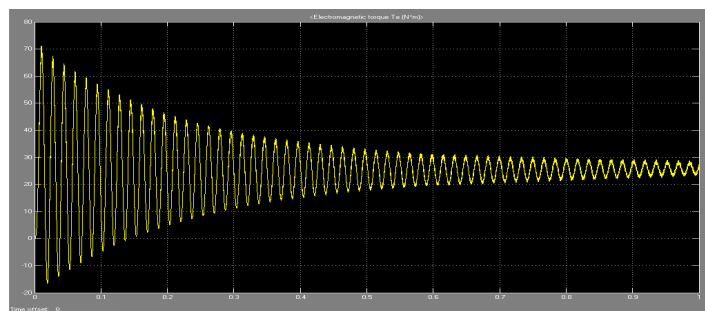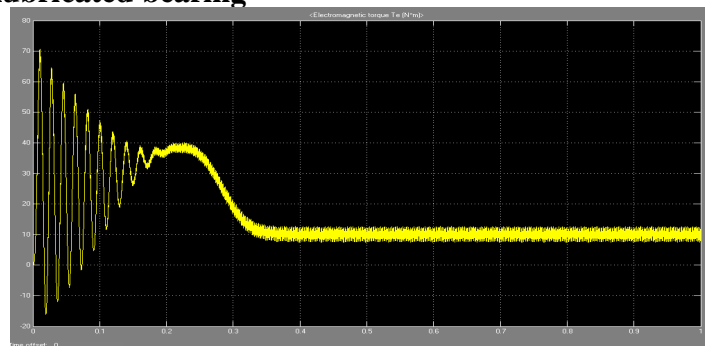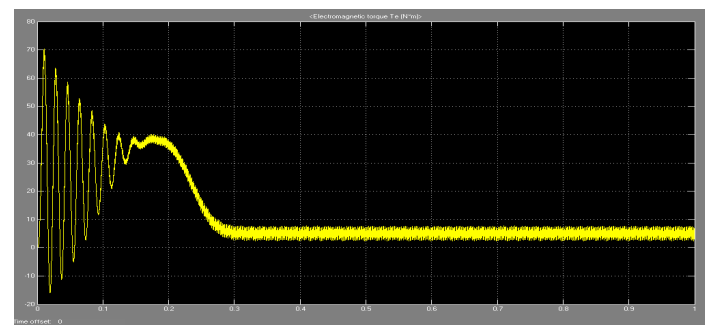**Fig. 6: Simulation of Inter-turn fault (a) Stator phase-A current at current by shorting 20% of the total winding total impedance (b) current by shorting 50% of the total winding (c) current by shorting 75% of the total winding.**

**(B) Bearing Failure****a) Torque of damage bearing****b) Torque of dry bearing****c) Torque of less lubricated bearing****d) Torque of lubricated bearing**

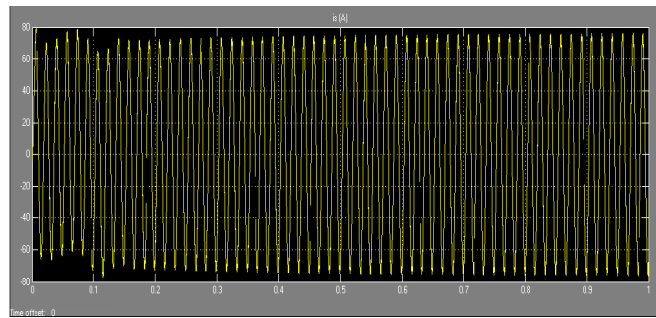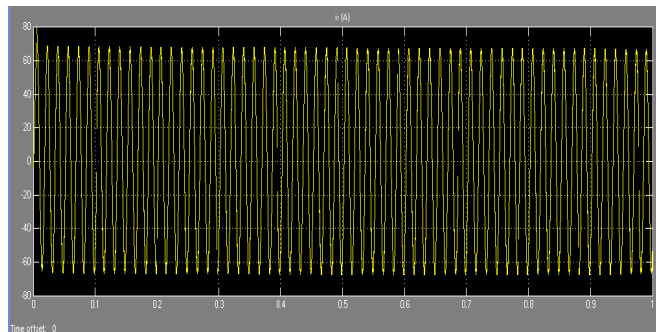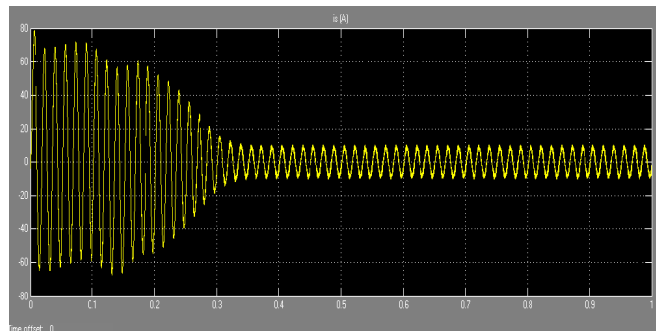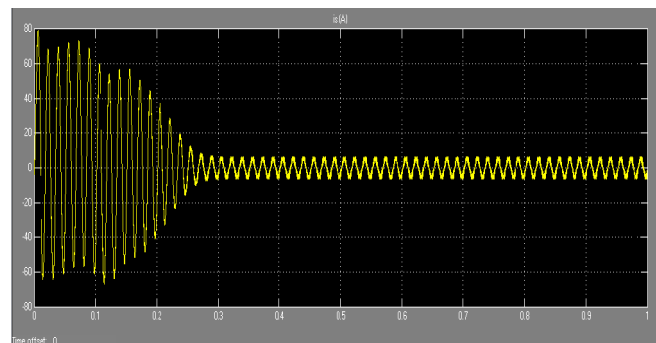**Fig. 7: Simulation of Bearing Failure (a) Torque of damage bearing (b) Torque of dry bearing (c) Torque of less lubricated bearing (d) Torque of lubricated bearing.**

**a) Current of damage bearing****b) Current of dry bearing****c) Current of less lubricated bearing****d) Current of lubricated bearing**

**Fig. 7: Simulation of Bearing Failure (a) Stator current of damage bearing (b) Stator current of dry bearing (c) Stator current of less lubricated bearing (d) Stator current of lubricated bearing.**



## CONCLUSION

This paper presented the successful simulation and modeling of induction motor with traditional electrical machine models. It has been demonstrated that a generalized motor model can be used to simulate induction motor faults to a high degree of accuracy.

This paper present simulation of three phase induction motor in Matlab for two types of incipient fault i.e., intern turn and insulation failure of the winding. The simulated result shows decrease in winding equivalent turns will increase the stator –winding current of faulted phase, and thereby increase in temperature. Which further deteriorate the winding insulation causes the faulted current to flow through ground.

Also the result shows if the bearing deteriorates to fulfill the required load demand, the electrical torque increases. Therefore, the input current also rises.

The simulated result indicates that model-based fault detection and diagnosis is useful. The simulation showed that the dynamic characteristic of induction motors under different conditions can be obtained purely by Matlab simulation. With suitable model, motor faults may be simulated and predicted without any experimental analysis.

## REFERENCES

1. Makarand S. Ballal, Zaffar J. Khan, Hiralal M. Suryawanshi, Ram L. Sonolikar. “Adaptive Neural Fuzzy Inference System For The Detection of Inter-Turn Insulation and Bearing Wear Fault in Induction Motor.” IEEE Transactions on Industrial Electronics, February 2007; 54(1).
2. Olivier Ondel, Guy Clerc, Emmanuel Boutleux, Eric Blanco. “Fault Detection and Diagnosis in a Set “Inverter-Induction Machine” Through Multidimensional Membership Function and Pattern Recognition. IEEE Transactions on Energy Conversion, June 2009; 24(2).
3. Kyusung Kim, Alexander G. Parlos, “Induction Motor Fault Diagnosis based on Neuron Predictors and Wavelet Signal Processing IEEE Transactions on Mechatronics, June 2002; 7(2).
4. Wiehan Roux, Ronald G. Harley, Thomas G. Habetler, “Detection Rotor Fault in Low Power Permanent Synchronous Machine” IEEE Transactions on Power Electronics, January 2007; 22(1).
5. “P J Tamer and J Penman. ‘Condition Monitoring of Electrical Machines.’ Research Studies Press Ltd, Wiley, New York, 1989.

6. S A Nasar. 'Handbook of Electric Machines.' Substitutes New York: Mc Graw Hill, chapter, 1987. 3-4.
7. A E Fitzgerald, C Kingsley and S D Umas. 'Electric Machinery. 5<sup>th</sup> edition.' McGraw Hill, chapter 11, New York, 1990.
8. Mo –Yuen Chow, R N Sharpe and J C Hung. 'On the Application and Design of Artificial Neural Networks for Motor Fault Detection –Part I and II.' IEEE Transaction on Industrial Electronics, April 1993; 40(2): 181–196.
9. Paul V Goode and Mo–Yuen Chow. 'Using a Neural/Fuzzy System to Extract Heuristic Knowledge of Incipient Faults in Induction Motors: Part I and II.' IEEE Transaction on Industrial Electronics, April 1995; 42(2): 131–146.
10. Mo–Yuen Chow and Paul V Goode. 'Adaptation of neural/Fuzzy Fault Detection System.' Procee-dings of IEEE Conference on Decision and Control, December 1993; 1733 –1738.
11. M Y Chow and S O Yee. 'Methodology for On–line Incipient Fault Detection in Single–phase Squirrel– cage Induction Motors Using Artificial Neural Networks.' IEEE Transaction on Energy Conversation, September 1991; 6(3): 536 – 545.

## X: BIOGRAPHIES



**Dr. Z. J. Khan** was born in 1962. He received the B. E. Degree in electrical engineering in 1986 and M. tech degree in electrical engineering from the Visvesvaraya National Institute of Technology Nagpur, India and the Ph.D. degree from regional Engineering College, Warangal(A.P.), India, in 1996

He was the Dean of faculty of engineering and Technology and also the chairman the board of studies at Nagpur university from 2001 to 2006. He is currently working as a professor and Head of the Department of Electrical Engineering, Rajiv Gandhi College of Engineering, research and Technology, Chandrapur India. His area of research interest are power electronics, power system modeling /analysis, and energy audit



**Vikas P. Dongare** was born in Amravati in India, on March 9, 1976. He graduated from Government College of Engineering, Amravati affiliated to Amravati University in 1998 with a B.E. degree in Electrical graduation in Electrical Power Systems from Government College Of Engineering Amravati affiliated to Amravati University in 2005. He is working as a Junior Engineer in Testing Unit Maharashtra state Electricity Transmission Co. Amravati.